

## VRF Indoor Unit

### MIH450FAHN18 – Fresh Air Processing Unit

1-phase, 220-240V, 50/60Hz



## Submittal Data

Job name: \_\_\_\_\_

Location: \_\_\_\_\_

Tag: \_\_\_\_\_

Date: \_\_\_\_\_



#### MIH450FAHN18 Features:

- ♦ High efficiency DC fan motor
- ♦ 100% Fresh Air Processing Unit, both fresh air filtration and heating/cooling can be achieved in a single system
- ♦ 20-step static pressure control (requires latest generation wired controllers)
- ♦ External static pressure can be up to 400Pa
- ♦ 7-speed fan control
- ♦ Built-in EXV

#### Specifications:


Model			MIH450FAHN18
Cooling <sup>1</sup>	Capacity	kW	45.0
		kBtu/h	153.6
	Power input	W	900
Heating <sup>2</sup>	Capacity	kW	27.8
		kBtu/h	94.9
	Power input	W	900
Air flow rate <sup>3</sup>		m <sup>3</sup> /h	4500/4217/3933/3650/3367/3083/2800
External static pressure		Pa	300 (0-400)
Sound pressure level <sup>4</sup>		dB(A)	53/52/52/51/50/49/48
Net dimensions <sup>5</sup> (W×H×D)		mm	1850×550×900
Packed dimensions (W×H×D)		mm	2080×730×1060
Net/Gross weight		kg	161/198
Pipe connections	Liquid/Gas pipe	mm	Φ16/Φ28.6
	Drain pipe	mm	OD Φ32
Operating temperature range		°C	Heating: -5 to 16; Cooling: 20 to 43; Fan only: 5 to 48
Minimum Circuit Amps (MCA)		A	6.56
Recommended Fuse Size (MFA)		A	15

#### Notes:

1. Outdoor air temperature 33°C DB, 28°C WB; equivalent refrigerant piping length 7.5m with zero level difference.
2. Outdoor air temperature 0°C DB, -2.9°C WB; equivalent refrigerant piping length 7.5m with zero level difference.
3. Air flow rate are from the highest speed to the lowest speed, total 7 rates for each model.
4. Sound pressure level is from highest level to lowest level, total 7 levels for each model. Sound pressure level is measured 1.5m below the unit in a semi-anechoic chamber.
5. Unit body dimensions given are the largest external dimensions of the unit, including hanger attachments.

## Dimensional Drawing:

Unit (mm)

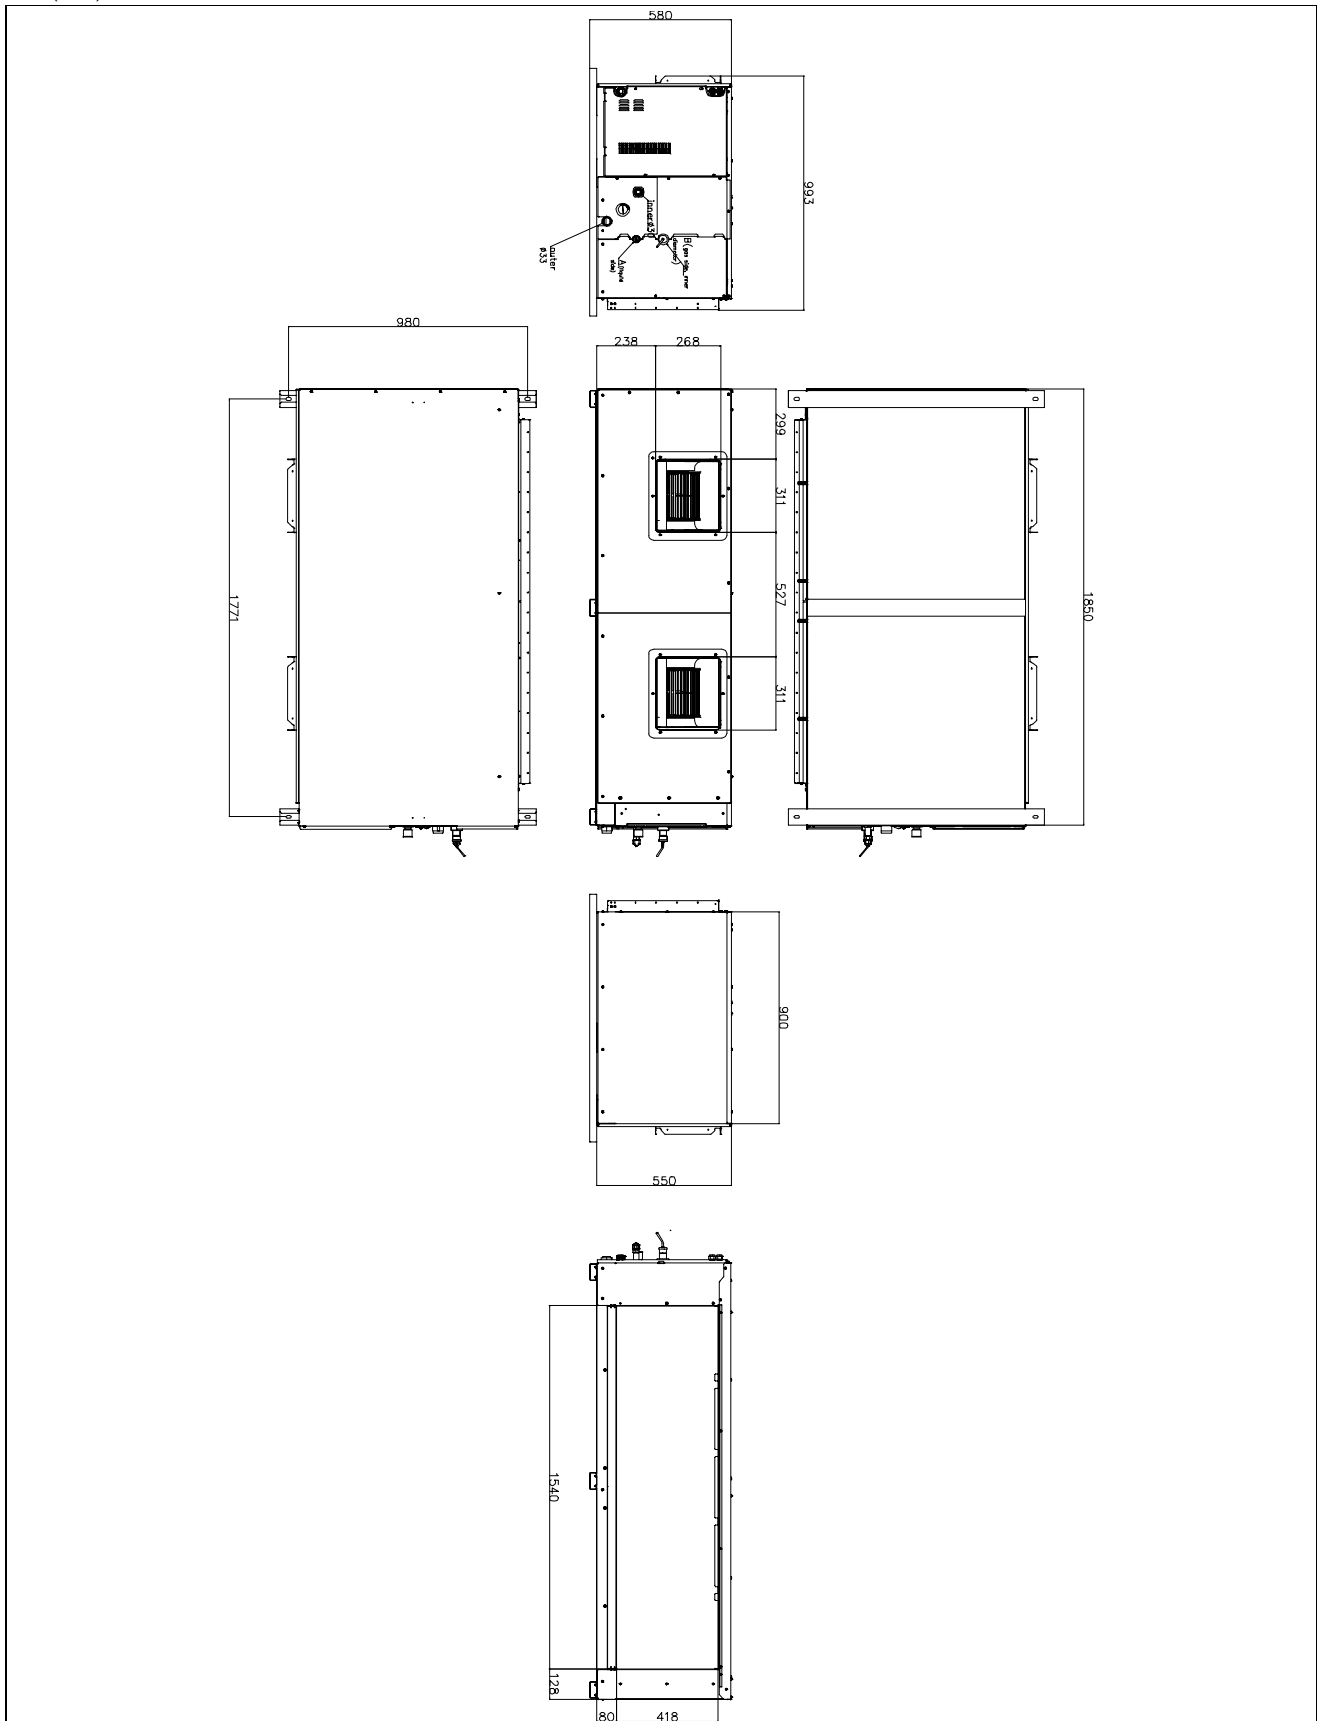

Product specifications change from time to time as product improvements and developments are released and may vary from those in this document.